



REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

NOTES:

1. A DROP MANHOLE SHALL BE USED WHEN SEWER MAIN IS MORE THAN 12" ABOVE THE MANHOLE BOTTOM.
2. FOR SEWER MAINS LESS THAN 12" ABOVE THE MANHOLE BOTTOM, A CONCRETE TROUGH SHALL BE INSTALLED TO INSURE SMOOTH TRANSITION FROM PIPE TO MANHOLE.
3. MANHOLES SHALL BE WATER-TIGHT.
4. FOR SEWER MAINS 12" DIAMETER OR LARGER, MANHOLE MUST BE LINED WITH "SANCON" OR APPROVED EQUAL.
5. BROKEN OR CHIPPED RINGS AND CONES SHALL NOT BE USED.

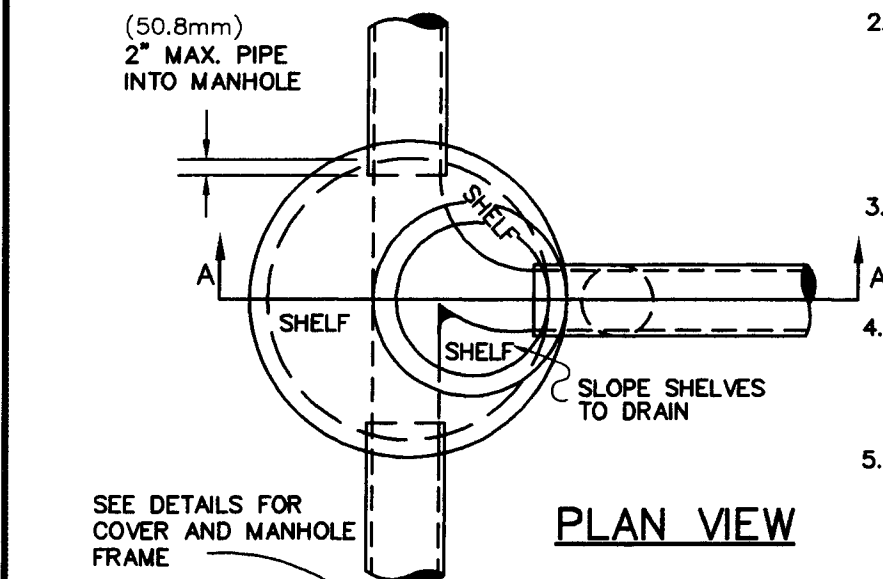

PLAN VIEW

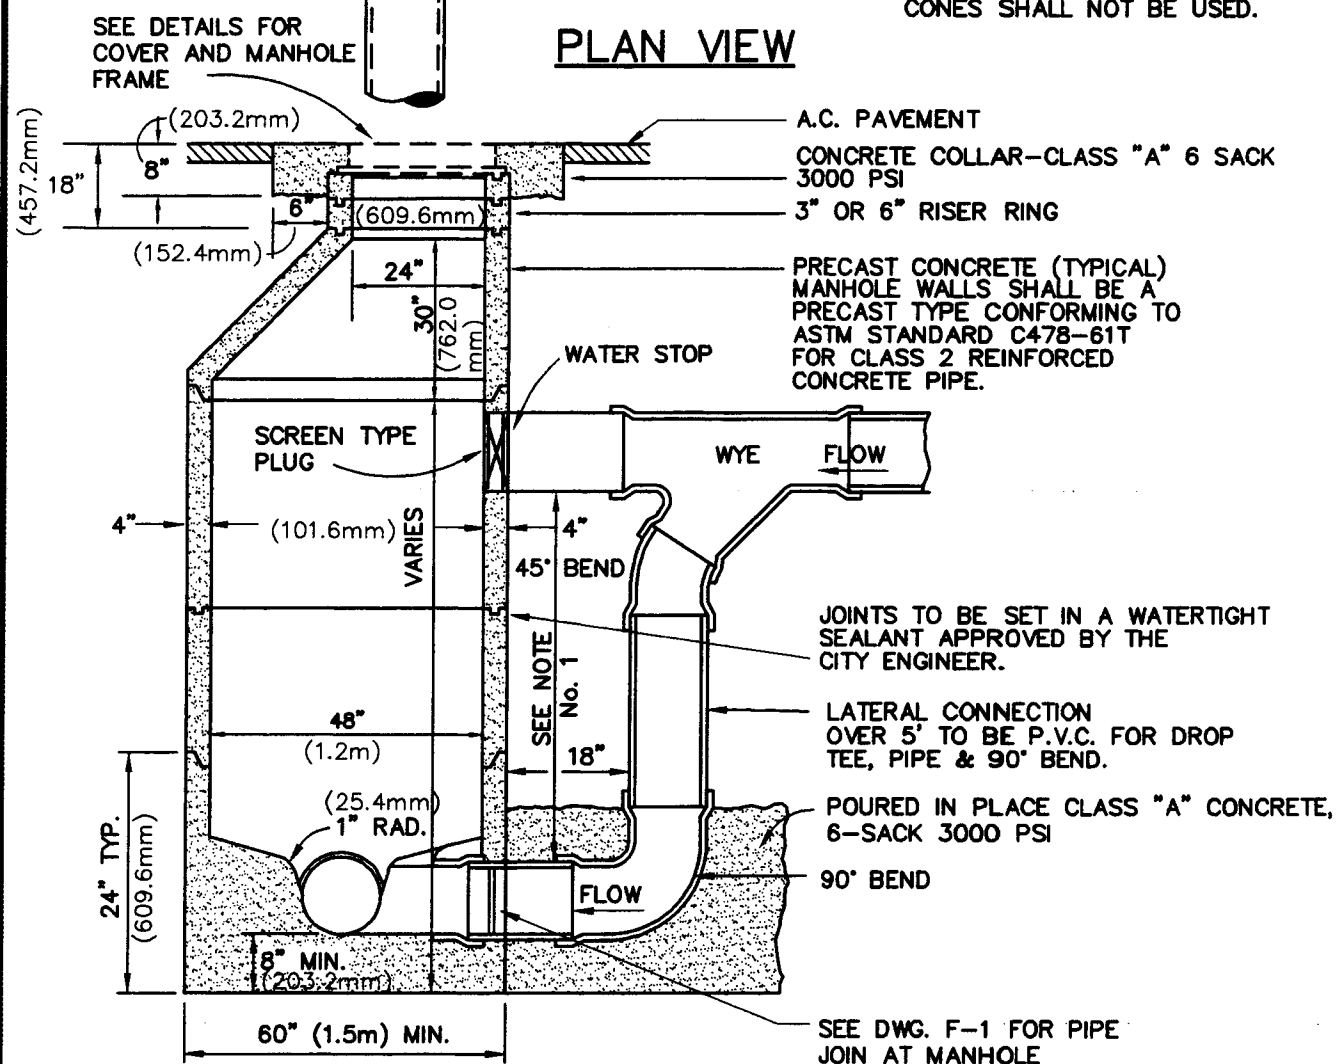

SECTION A-A

DRAWN BY: C.A.C.	CITY OF PASO ROBLES ENGINEERING DIVISION	DRAWING NO.
DESIGNED BY:		
DATE: 4/18/94	DROP MANHOLE	F-3
FILE NAME: PR-F-3.DWG		